



**ADDENDUM NO. 1**  
**TO THE PLANS, SPECIFICATIONS, PROPOSAL AND CONTRACT**  
**FOR CITY OF LACEY**  
**400 PRESSURE ZONE TRANSMISSION MAIN**  
**LACEY CONTRACT NO. PW 2023-25**

This addendum is made part of these contract documents as though it was originally included in the Contract. The Contractor shall note the location of the Addenda Receipt Acknowledgement on Page B-3 of the Contract Proposal.


Issued this 11th day of December 2024.



**ITEM NO. 1-1: REPLACE SEWER SHEET S1**

Replace Sheet S1 (9) with the attached revised S1(A) (9A). The connection and valve locations have been changed.


**ITEM NO. 1-2: REPLACE BID SHEETS B-1, B-2, AND B-3 IN THE SPECIAL PROVISIONS**

Replace Bid Sheet B-1, B-2, and B-3 with Addendum Bid Sheets B-1, B-2, and B-3. The "6 Inch Diameter Force Main Sewer Pipe" quantity has been increased.

  
Scott Egger, P.E.  
Public Works Director

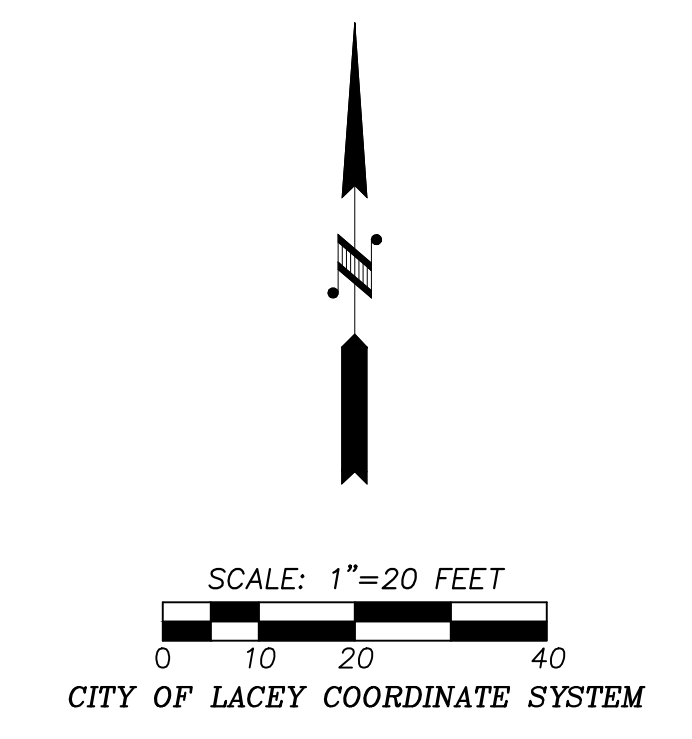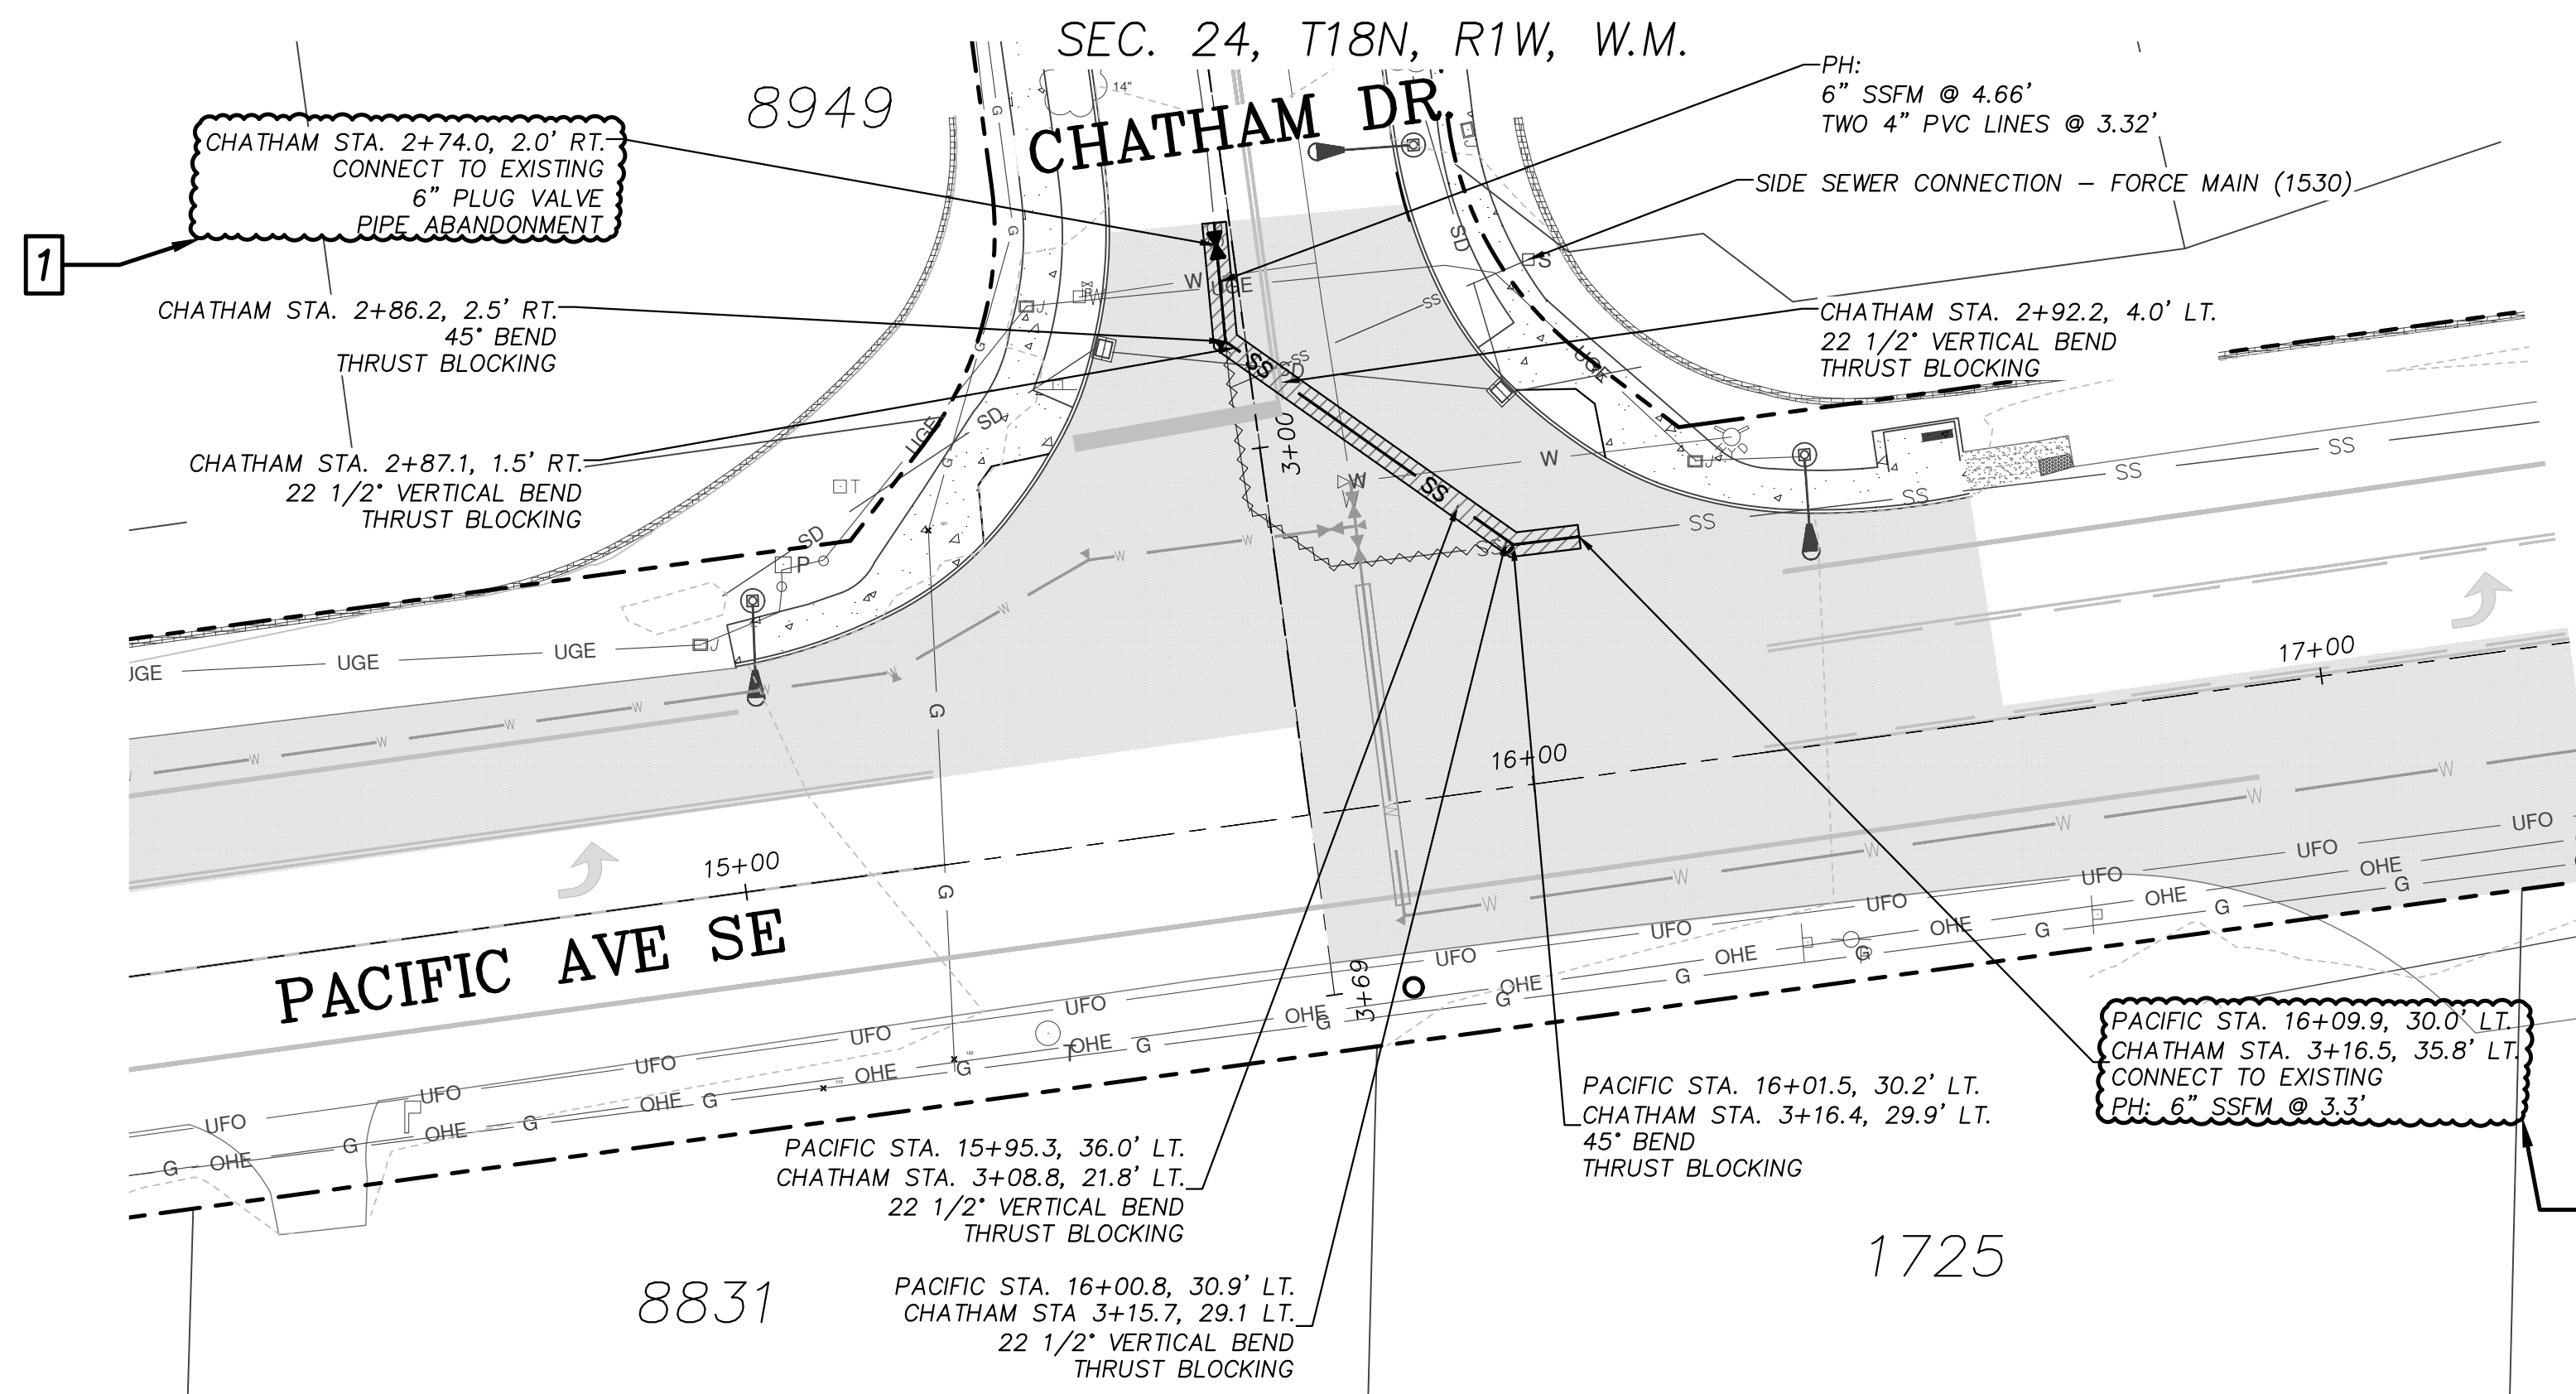


- CONSTRUCTION NOTES:**
1. ALL JOINTS SHALL BE RESTRAINED.
  2. MAINTAIN A MINIMUM OF 18" VERTICAL SEPARATION BETWEEN THE TOP OF THE STEP MAIN AND THE BOTTOM OF THE WATER MAIN.
  3. WORK ON THIS SHEET WILL REQUIRE FIELD FIT.
  4. ALL CUT ENDS OF ABANDONED PIPE SHALL BE PLUGGED WITH WATERTIGHT GROUT PER 7-08.3(5).
  5. CONTRACTOR TO VERIFY LOCATION, DEPTH, AND FITTING REQUIRED TO CONNECT TO THE EXISTING STEP MAIN AT CONNECTION POINTS PRIOR TO CONSTRUCTION.
  6. CONTRACTOR TO POTHOLE ALL UTILITY CROSSINGS 72 HOURS PRIOR TO WATER AND STEP MAIN INSTALLATION. NOTIFY THE ENGINEER OF ANY CONFLICTS.
  7. THE SEWER SERVICE LINE LOCATION IS APPROXIMATE. THE CONTRACTOR SHALL VERIFY ITS LOCATION PRIOR TO CONSTRUCTION. A NEW SERVICE CONNECTION WILL ONLY BE REQUIRED IF THE EXISTING SERVICE IS CONNECTED TO THE SEGMENT OF THE EXISTING MAIN TO BE ABANDONED.

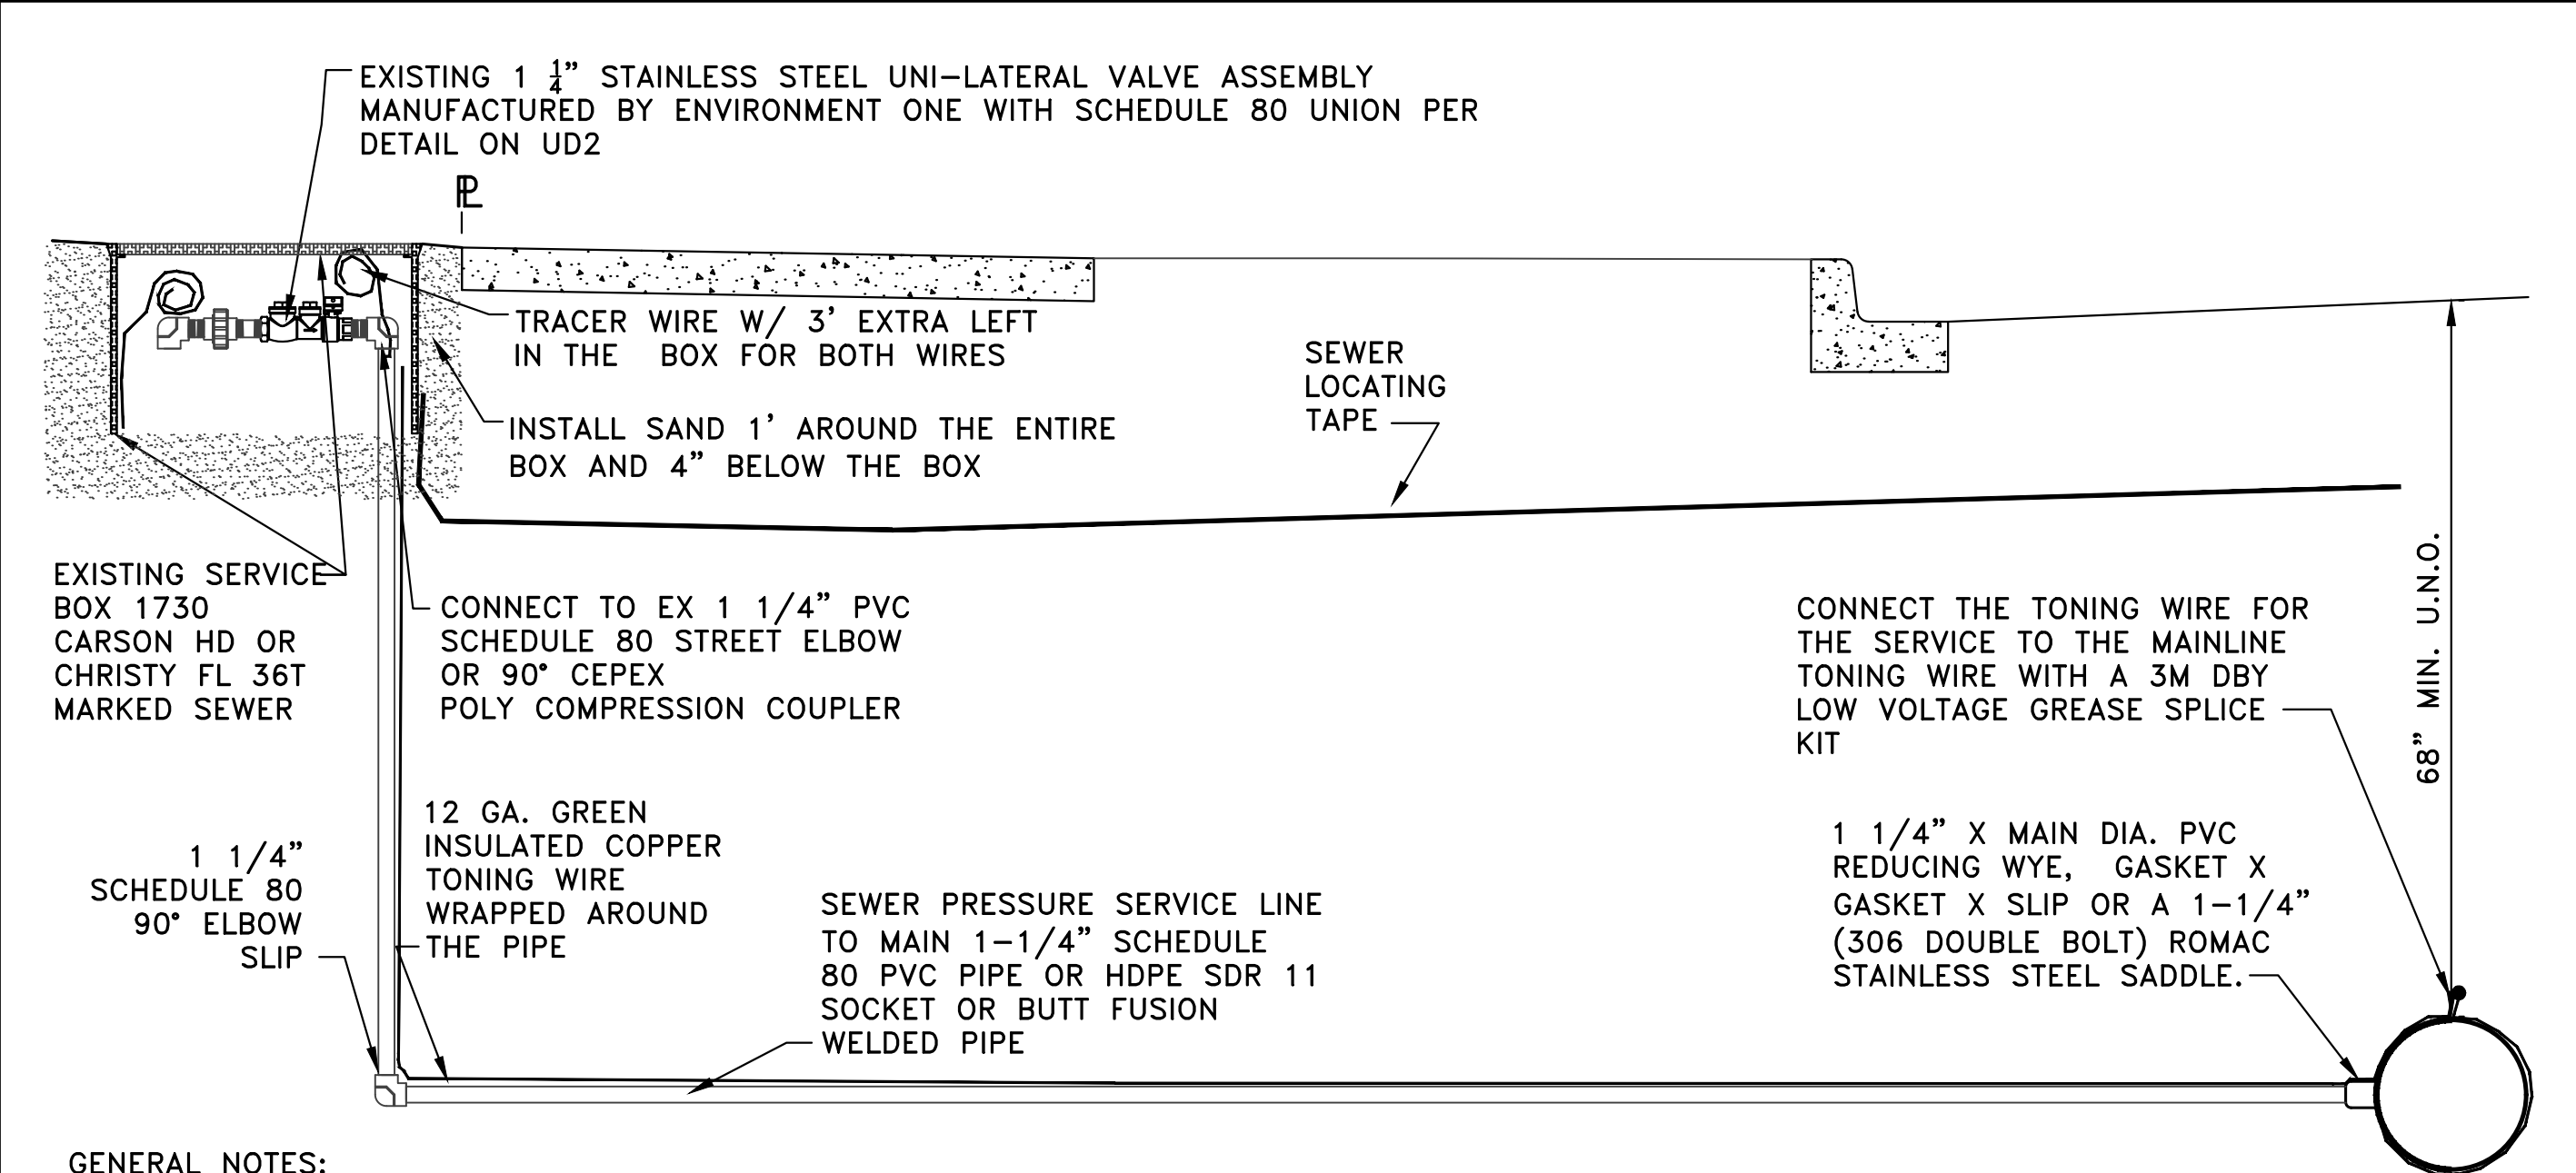

- GENERAL NOTES:**
1. FILL SERVICE BOX WITH FIBERGLASS INSULATION AT TIME OF ON-SITE CONNECTION TO THE STUB.
  2. AFTER THE HYDRO-STATIC TEST HAS BEEN APPROVED BY THE CITY INSPECTOR THE CHECK VALVE SHALL BE INSTALLED.
  3. HDPE SHALL BE HI DENSITY ASTM D 3350, SDR 11 4710 SOCKET OR BUTT FUSION WELDED AND BE SIZED BY INSIDE PIPE DIAMETER. ALL HDPE PIPE USED FOR SEWER SHALL BE GREEN OR BLACK WITH A GREEN STRIP MANUFACTURED ON THE PIPE.
  4. INSTALL THE SERVICE BOX IN A NON-TRAFFIC AREA.
  5. TO TRANSITION FROM HDPE TO PVC A 316 STAINLESS STEEL "POLY CAM" CONNECTOR SHALL BE USED.

SINGLE FAMILY S.T.E.P. SEWER SERVICE CONNECTION  
N.T.S.

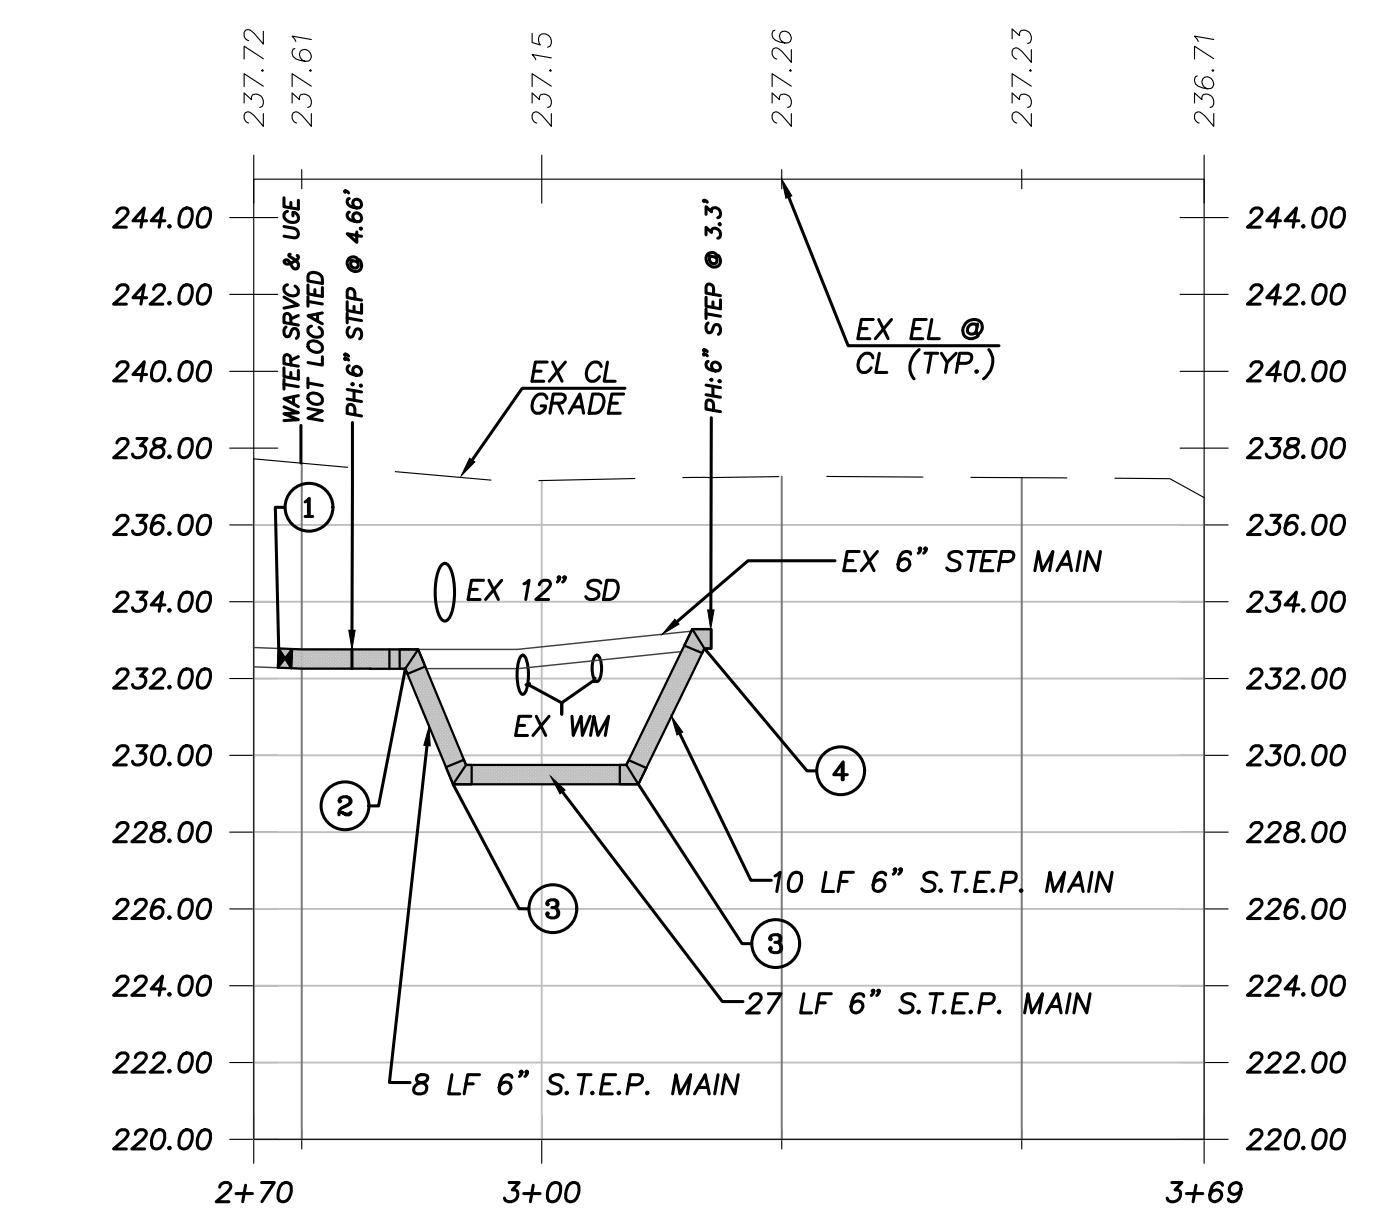

CHATHAM DR 2+70 - 3+69

NODE	FITTINGS
①	6" PLUG VALVE
②	45° BEND
③	22 1/2" VERTICAL BEND
④	22 1/2" VERTICAL BEND
	45° BEND

**CITY OF LACEY, WASHINGTON**  
DEPARTMENT OF PUBLIC WORKS  
420 COLLEGE STREET SE  
LACEY, WA 98503-1238 (360) 491-5600



DESIGNED: RKJ  
DRAFTED: RKJ  
CHECKED: TEO  
HORZ. SCALE: 1"=20'  
VERT. SCALE: 1"=5'  
NOTICE-IMPROVEMENTS ADDENDUM

**400 PZ TRANSMISSION MAIN  
SEWER RELOCATION**

REVISION BLOCK			PAGE NO.	SHEET NO.
NO.	DATE	DESCRIPTION	S1(A)	9A
1	12/9/24	Pipe Restraint Revisions		
			DWG NO.	OF
			D-23-19	17

---

# CITY OF LACEY

400 Pressure Zone Transmission Main

## ADDENDUM #1

---

Lacey Contract Number: PW 2023-25

Federal Aid Project Number:

WSDOT Contract Number:

TIB Contract Number:

---

## Contract Proposal

---

DATE: \_\_\_\_\_

The undersigned, as bidder, has examined the bid documents as prepared by the Public Works Department, City of Lacey.

The undersigned, as bidder, proposes to furnish all material and perform all labor in accordance with the bid documents at the following prices.

Bidder must fill in unit prices in figures for each item and total.

Bidder shall sign this proposal form and submit all required paperwork with the bid.

---

### A Water

---

No.	Quantity	Unit	Item ID	Item Description	Unit Price	Extended Price
A1	75000	MC	104-010	Minor Change	\$1.00	\$75,000.00
A2	1	LS	109-010	Mobilization	LUMP SUM	
A3	1	LS	110-010	Project Temporary Traffic Control	LUMP SUM	
A4	1100	HR	110-040	Flaggers		
A5	1280	HR	110-070	Portable Changeable Message Sign		
A6	1	LS	202-510	Removal of Structures and Obstructions	LUMP SUM	
A7	300	CY	203-120	Unsuitable Foundation Excavation Incl. Haul		
A8	1	LS	205-510	Trench Safety System	LUMP SUM	
A9	450	TN	404-010	Crushed Surfacing Base Course		
A10	8	TN	404-020	Crushed Surfacing Top Course		
A11	920	TN	504-011	HMA Cl. 1/2" PG 58H-22		
A12	450	TN	504-016	HMA for Pavement Repair Cl. 1/2" PG 58H-22		
A13	7	TN	504-110	Commercial HMA		
A14	7800	SY	504-200	Planing Bituminous Pavement		
A15	1	LS	504-610	Preparation of Existing Surfaces	LUMP SUM	
A16	1	LS	504-620	Driveway and Shoulder Preparation	LUMP SUM	
A17	30	TN	504-630	Crushed Rock for Shoulder Grading		
A18	400	TN	708-610	Bank Run Gravel for Trench Backfill		
A19	1200	TN	708-620	Imported Pipe Bedding		
A20	24	HR	708-810	Utility Potholing		
A21	40	LF	708-924	24 Inch Pipe Encasement		

A22	3150	LF	709-512	12 Inch D.I. Water Main		
A23	3	EA	709-950	Connect to Existing Water Main		
A24	3	EA	709-960	Pipe Abandonment		
A25	4	EA	712-506	6 Inch Gate Valve		
A26	1	EA	712-508	8 Inch Gate Valve		
A27	12	EA	712-512	12 Inch Gate Valve		
A28	2	EA	712-517	16 Inch Gate Valve		
A29	1	EA	712-610	2 Inch Air and Vacuum Release Valve		
A30	3	EA	712-910	Adjust Valve Box		
A31	4	EA	714-510	Hydrant Assembly		
A32	1	EA	715-850	Sampling Station		
A33	70	LF	717-706	6 Inch Diameter Force Main Sewer Pipe		
A34	1	EA	717-806	6 Inch Plug Valve		
A35	1	EA	717-852	Side Sewer Connections - Force Main		
A36	2	EA	717-960	Connect to Existing Sanitary Sewer Force Main		
A37	1	FA	723-515	Bypass Pumping	\$5,000.00	\$5,000.00
A38	1	LS	801-010	ESC Lead	LUMP SUM	
A39	0.15	AC	801-550	Seeding, Fertilizing, and Mulching		
A40	1	LS	801-680	Erosion/Water Pollution Control	LUMP SUM	
A41	30	CY	802-010	Topsoil Type A		
A42	30	CY	802-570	Medium Compost		
A43	1	LS	805-510	Lawn and Landscape Restoration	LUMP SUM	
A44	0.16	MILE	808-020	Centerline Rumble Strip		
A45	0.65	HUND	809-040	Recessed Pavement Marker		
A46	1	EA	813-510	Cast-in-Place Monument		
A47	5650	LF	822-010	Paint Line		
A48	75	LF	822-150	Plastic Stop Line		
A49	36	LF	822-670	Plastic Crosswalk Line		
A50	8400	LF	823-010	Temporary Pavement Marking - Short Duration		
A51	1	LS	850-792	Project Closeout	\$5,000.00	\$5,000.00

Schedule A Subtotal: \_\_\_\_\_

Tax Rate (%) : 9.50 Tax: \_\_\_\_\_

Schedule A Total: \_\_\_\_\_

**Contract Total:** \_\_\_\_\_  
(All Schedules)

